


EAL February 2018 report

Nov 2017

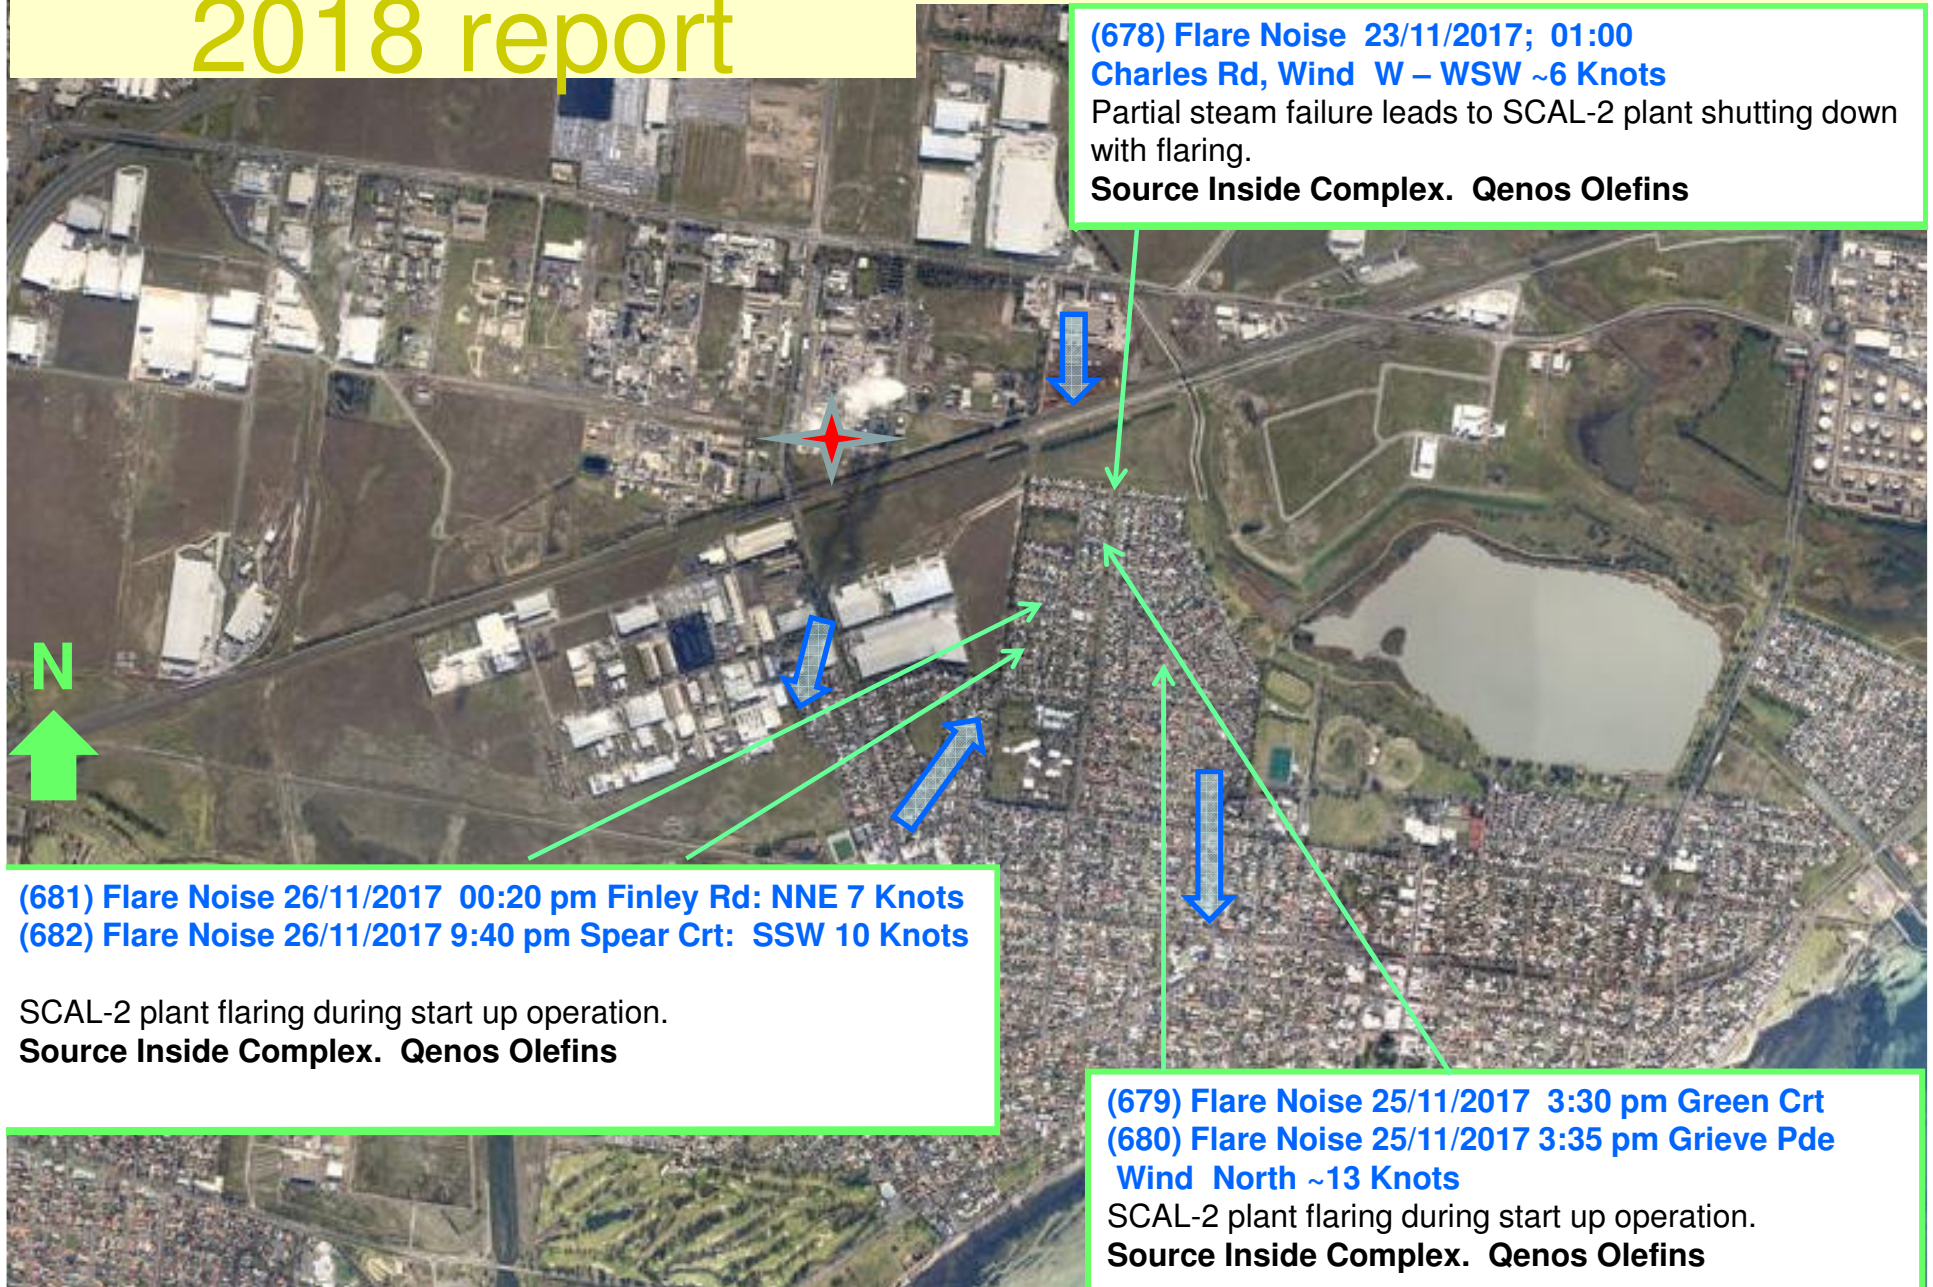

(678) Flare Noise 23/11/2017; 01:00
Charles Rd, Wind W – WSW ~6 Knots
Partial steam failure leads to SCAL-2 plant shutting down
with flaring.
Source Inside Complex. Qenos Olefins


(681) Flare Noise 26/11/2017 00:20 pm Finley Rd: NNE 7 Knots
(682) Flare Noise 26/11/2017 9:40 pm Spear Crt: SSW 10 Knots

SCAL-2 plant flaring during start up operation.
Source Inside Complex. Qenos Olefins

(679) Flare Noise 25/11/2017 3:30 pm Green Crt
(680) Flare Noise 25/11/2017 3:35 pm Grieve Pde
Wind North ~13 Knots
SCAL-2 plant flaring during start up operation.
Source Inside Complex. Qenos Olefins

EAL

Dec 2017

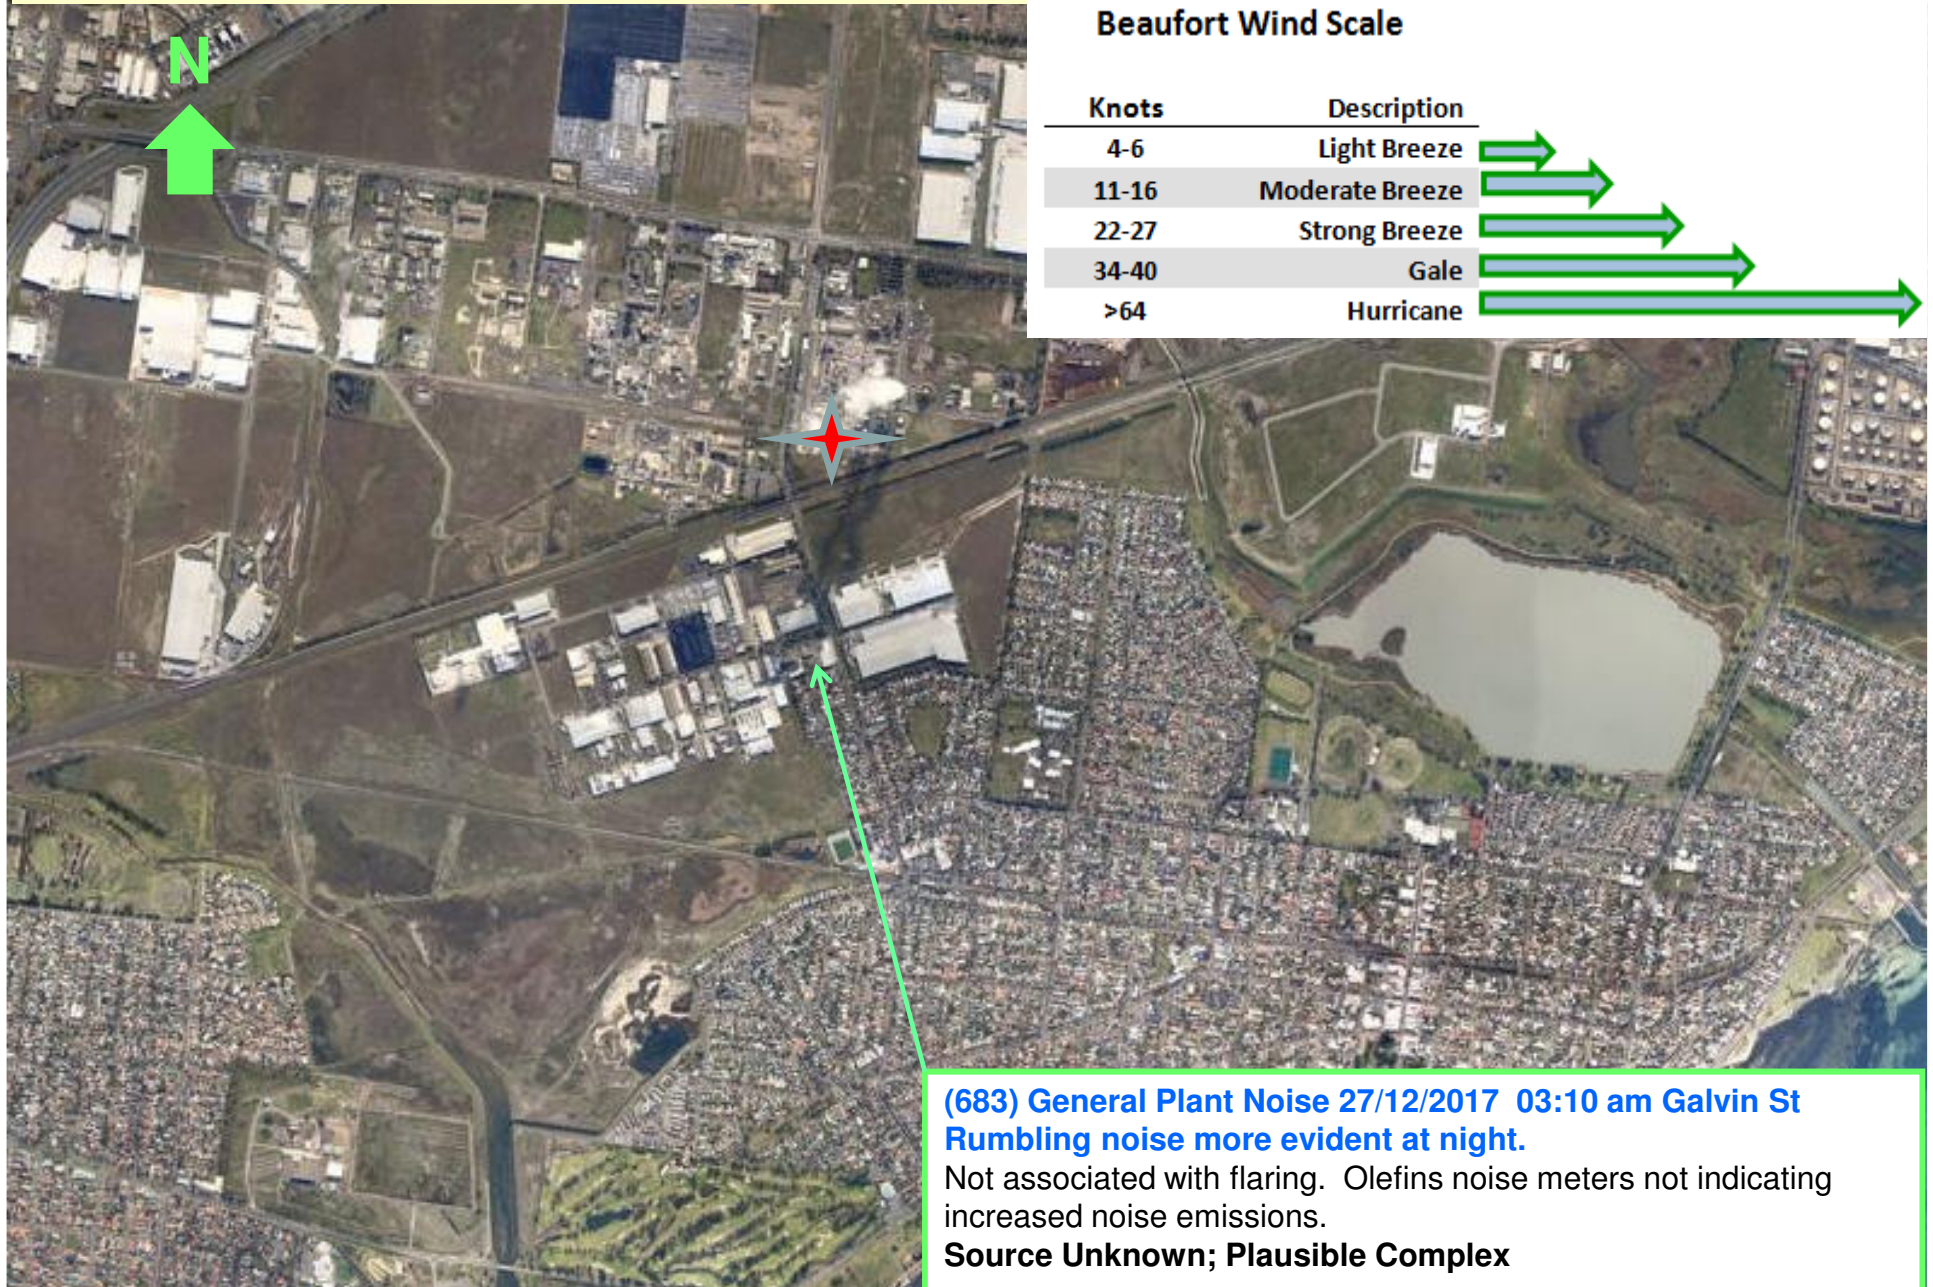

Beaufort Wind Scale

Knots	Description
4-6	Light Breeze
11-16	Moderate Breeze
22-27	Strong Breeze
34-40	Gale
>64	Hurricane

(683) General Plant Noise 27/12/2017 03:10 am Galvin St
Rumbling noise more evident at night.

Not associated with flaring. Olefins noise meters not indicating increased noise emissions.

Source Unknown; Plausible Complex

EAL

Jan 2018



(684) Petroleum Odour 19/1/2018 00:10 am Charles Rd
Wind NW 9-12 Knots

Primary sour water stripper off line for maintenance resulting in slightly more odorous ETP, storm pond draining.
Source Inside Complex. Genos Olefins

EAL 12 Months to February 2018

